

## FBM216 HART® Communication Redundant Input Interface Module



The FBM216 offers redundant modules for eight input channels, each accepting a 4 to 20mA analog signal or a digital HART® signal superimposed on a 4 to 20 mA analog signal.

### FEATURES

Key features of the FBM216 module are:

- ▶ Eight analog input channels, each accepting one of the following inputs:
  - Standard 4 to 20 mA analog sensor signal
  - Digital HART Frequency Shift Keying (FSK) signal superimposed on a 4 to 20 mA analog signal.
- ▶ Module pair offers redundancy at the FBM level
- ▶ FSK modem dedicated to each input channel for bi-directional digital communications with a HART field device
- ▶ Analog to digital conversion of each of the 4 to 20 mA input signal from the HART devices
- ▶ Support for the HART universal commands necessary to interface the field device with the I/A Series® system database
- ▶ Galvanic isolation of the group of 8 input channels from ground and module logic
- ▶ Compact, rugged design suitable for enclosure in Class G3 (harsh) environments
- ▶ High accuracy achieved by sigma-delta data conversions for each channel
- ▶ Termination Assemblies (TAs) for locally or remotely connecting field wiring to the FBM216
- ▶ Termination Assemblies for per channel internally and/or externally loop powered transmitters.

## OVERVIEW

The FBM216 HART Communication Redundant Input Interface Module contains eight group-isolated input channels. The FBM216 supports any mix of standard 4 to 20 mA devices and HART devices.

A pair of modules combines to provide redundancy at the Fieldbus Module (FBM) level, with field inputs wired to one common termination assembly (see Figure 1). In this configuration, one FBM216 is the Master, and the other is the Tracker.

The FBM216 serves as a HART communications field device host, enabling the I/A Series system to request and receive two digital messages per second from each field device. The message pass-through capability can be used to support HART universal, common practice, and device-specific commands, but not the burst communication mode. These commands are implemented using the Intelligent Field Device Configurator (IFDC — refer to PSS 21S-8A2 B3 for details).

The FBM216 provides a common isolated power supply to power all eight channels. Optionally, the channels can be powered by an external power supply, in which case a Cable Balun module is required to prevent channel crosstalk.

## HIGH ACCURACY

For high accuracy, the module incorporates a Sigma-Delta converter which can provide new analog input values for each channel every 100 milliseconds.

## COMPACT DESIGN

The FBM216 has a compact design, with a rugged extruded aluminum exterior for physical protection of the circuits. Enclosures specially designed for mounting the FBMs provide various levels of environmental protection, up to harsh environments per ISA Standard S71.04.

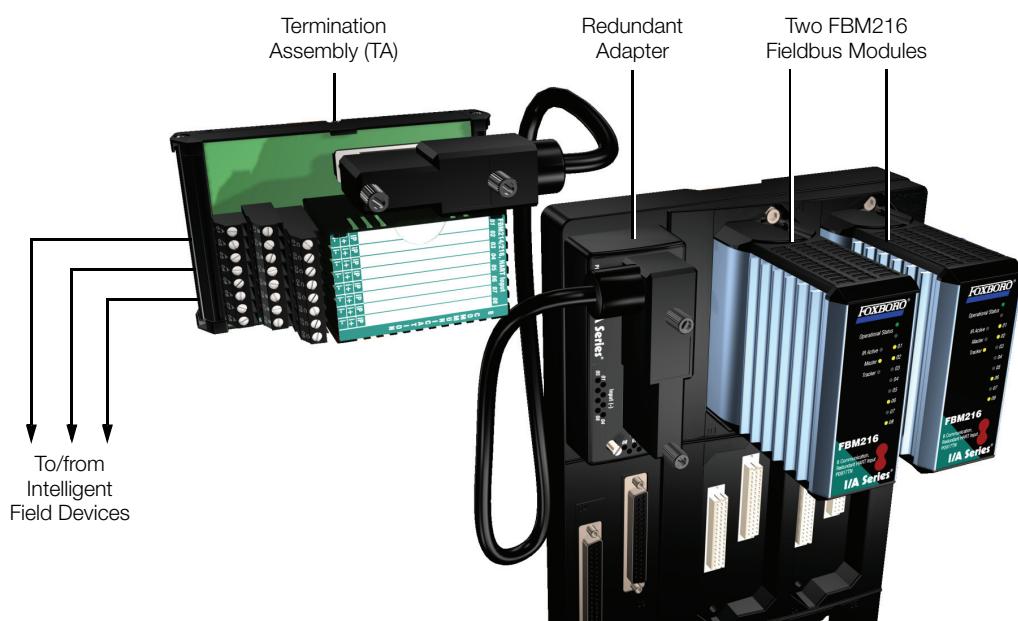


Figure 1. Redundant Module Configuration

## HIGH RELIABILITY

The redundancy of the module pair, coupled with the high coverage of faults, provides very high subsystem availability time.

Either module may be replaced without upsetting field input signals to the other module. A module can be removed or replaced without removing field device termination cabling, power, or communications cabling.

## REDUNDANT ANALOG INPUTS

For each input operation, identical reads are sent to both modules, fully exercising the Fieldbus and the logic circuitry of each module. Each input channel accepts an analog sensor input or a self-powered 4 to 20 mA source. Device power from each module is diode OR'd together in the redundant adapter to ensure redundant power.

The microprocessor of each module executes the analog I/O application program, plus security routines that validate the health of the FBM. Input channel security is enhanced by redundantly powering the input current loop from per-channel power supplies in each module of the pair.

## VISUAL INDICATORS

Light-emitting diodes (LEDs) incorporated into the front of the module provide visual indication of the module's operational and redundancy status, and communication activity on the channels. Two additional LEDs provide the master or tracker status of the modules.

## FIELDBUS COMMUNICATION

A Fieldbus Communication Module or a Control Processor interfaces the redundant 2 Mbps module Fieldbus used by the FBMs. The FBM216 module accepts communication from either path (A or B) of the redundant 2 Mbps fieldbus – should one path fail or be switched at the system level, the module continues communication over the active path.

The use of an external power supply common to two or more loops requires a Cable Balun module to maintain communication signal line balance.

## MODULAR BASEPLATE MOUNTING

The module mounts on a modular baseplate which accommodates up to four or eight FBMs. The modular baseplate is either DIN rail mounted or rack mounted, and includes signal connectors for redundant fieldbus, redundant independent dc power, and termination cables.

Redundant modules must be located in adjacent positions on the baseplate (positions 1 and 2, 3 and 4, 5 and 6, or 7 and 8). To achieve redundancy, a redundant adapter module is placed on the two adjacent baseplate termination cable connectors to provide a single termination cable connection (see Figure 1). A single termination cable connects from the redundant adapter to the associated termination assembly (TA).

## TERMINATION ASSEMBLIES

Field input signals connect to the FBM subsystem via DIN rail mounted TAs. The TAs used with the FBM216 are described in "TERMINATION ASSEMBLIES AND CABLES" on page 9.



## CABLE BALUN MODULE

The Cable Balun module is used to maintain digital communication line balance for HART Transmitter to FBM loops that are powered from a common external power supply. This powering effectively connects one line of each loop together. Without the Baluns, in each loop so powered, the common connection at the external power supply, would cause near end crosstalk at the system end of the loop wiring cable. Loops using FBM internal power source do not require Baluns.

The Cable Balun module contains multiple Baluns. One Balun segment is interconnected in each loop powered from an external power supply per the diagram above. There is one Cable Balun module.

### Cable Balun Module

Module Model	Module Part No.	No. of Baluns in the Module
CBM-4	P0903SV	4

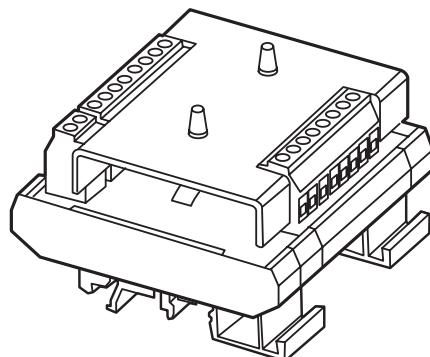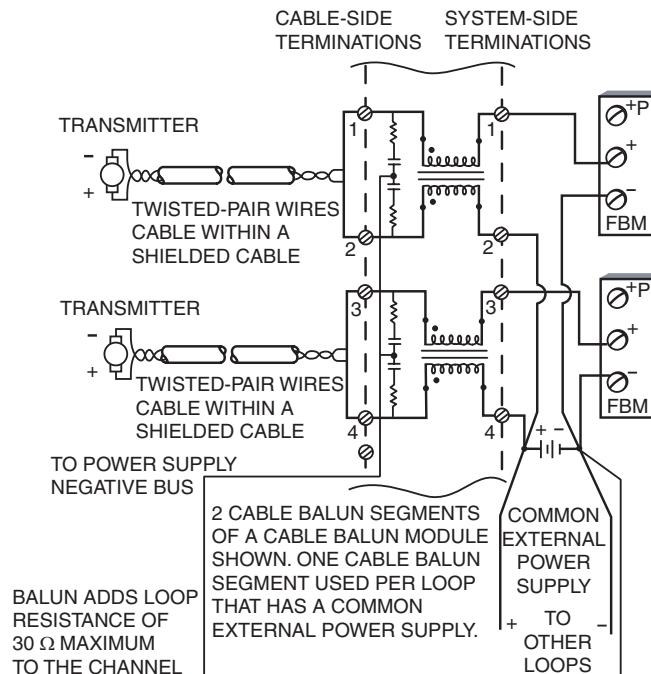

**CABLE BALUN MODULE**

*Figure 2. Cable Balun Module*

## FUNCTIONAL SPECIFICATIONS

### **Field Device Channels**

#### **VERSION SUPPORTED**

HART Protocol v6

#### **INTERFACE**

8 group-isolated channels

#### **COMMUNICATION TO THE DEVICE**

Point-to-point, master/slave, asynchronous, half-duplex, at 1200 baud

#### **ERROR CHECKING**

Parity on each byte, and one CRC check byte

#### **SPEED**

2 messages per second

#### **FASTEAST ALLOWED ECB BLOCK PERIOD**

500 msec

#### **MAXIMUM DISTANCE (FBM216 TO FIELD DEVICE)**

Meets HART FSK physical layer specification HCF\_SPEC-54, Revision 8.1 [up to 3030 m (10000 ft)]<sup>(1)</sup>

#### **COMPLIANCE VOLTAGE**

18 V dc minimum at 20.5 mA

#### **CURRENT INPUTS**

##### *Sense Resistor*

61.9 Ω nominal

##### *Total Input Resistance*

280 Ω minimum

##### *Analog Accuracy (Includes Nonlinearity)*

± 0.075%<sup>(2)</sup> of full scale

##### *Temperature Coefficient*

50 PPM/°C

##### *Resolution*

15 bits

##### *Update Rate*

100 ms

##### *Integration Time*

500 ms

#### *Common Mode Rejection*

>100 db at 50 or 60 Hz

#### *Normal Mode Rejection*

>35 db at 50 or 60 Hz

#### **LOOP POWER SUPPLY PROTECTION**

Each channel is galvanically group isolated, current limited, and voltage regulated.

All inputs are limited by their design to less than 30 mA with a single module installed (60 MA when redundant modules are installed). If the current limit circuit shorts out, the current is limited to about 85 mA.

#### **MAXIMUM LOOP RESISTANCE**

280 Ω (not including the field device)<sup>(3)</sup>

#### **FBM INPUT IMPEDANCE**

280 Ω minimum

#### **FBM INTERNAL POWER FOR FIELD DEVICE**

24 V dc ±10% common power supply for all channels. Loop load limited to one device per channel.

#### **ISOLATION**

The channels are not galvanically isolated from each other, but are galvanically isolated (both optical and transformer isolation) as a group from ground and module logic. Inputs use an internal FBM isolated power supply for field power. The module withstands, without damage, a potential of 600 V ac applied for one minute between the group isolated channels and earth (ground).

#### **CAUTION**

This does not imply that these channels are intended for permanent connection to voltages of these levels. Exceeding the limits for input voltages, as stated elsewhere in this specification, violates electrical safety codes and may expose users to electric shock.

(1) The maximum allowable distance decreases when the loop is operated through an intrinsic safety barrier. The maximum distance of the field device from the FBM is a function of compliance voltage, wire gauge and voltage drop at the device.

(2) Rev A through Rev F of FBM216 used with Rev A or Rev B of the Redundancy Adapter has an accuracy of 0.3% with external transmitter power or 0.6% with internal transmitter power. Use Rev G of FBM216 and Rev C of its Redundancy Adapter to obtain the accuracy of 0.075% for both power sources.

(3) In an intrinsic safety application, if a zener barrier is used between the FBM and the field device, the power supply must be set at 24 V dc +5%, -1%. There are no specific constraint with the use of galvanic barriers.

## FUNCTIONAL SPECIFICATIONS (CONTINUED)

### Fieldbus Communication

Communicates with its associated FCM or FCP via the redundant 2 Mbps module Fieldbus

### Power Requirements

#### INPUT VOLTAGE RANGE (REDUNDANT)

24 V dc ±5%

#### CONSUMPTION

7 W (maximum)

#### HEAT DISSIPATION

4 W (maximum)

### Regulatory Compliance

#### ELECTROMAGNETIC COMPATIBILITY (EMC)

##### *European EMC Directive 89/336/EEC*

Meets: EN 50081-2 Emission standard

EN 50082-2 Immunity standard

EN 61326 Annex A (Industrial Levels)

##### *CISPR 11, Industrial Scientific and Medical (ISM) Radio-frequency Equipment - Electromagnetic Disturbance Characteristics - Limits and Methods of Measurement*

Meets Class A Limits

##### *IEC 61000-4-2 ESD Immunity*

Contact 4 kV, air 8 kV

##### *IEC 61000-4-3 Radiated Field Immunity*

10 V/m at 80 to 1000 MHz

##### *IEC 61000-4-4 Electrical Fast*

##### *Transient/Burst Immunity*

2 kV on I/O, dc power and communication lines

##### *IEC 61000-4-5 Surge Immunity*

2kV on ac and dc power lines; 1kV on I/O and communications lines

##### *IEC 61000-4-6 Immunity to Conducted Disturbances*

10 V (rms) at 150 kHz to 80 MHz on I/O, dc power and communication lines

##### *IEC 61000-4-8 Power Frequency Magnetic Field Immunity*

30 A/m at 50 and 60 Hz

### PRODUCT SAFETY

European Low Voltage Directive 73/23/EEC

### SAFETY CERTIFICATION (FBM AND CABLE BALUN)

*Underwriters Laboratories (UL) for U.S. and Canada*

UL/UL-C listed as suitable for use in UL/UL-C listed Class I, Groups A-D; Division 2; temperature code T4 enclosure based systems. These modules are also UL and UL-C listed as associated apparatus for supplying non-incendive communication circuits for Class I, Groups A-D hazardous locations when connected to specified I/A Series® processor modules as described in the I/A Series DIN Rail Mounted Subsystem User's Guide (B0400FA). Where power is supplied by the FBM, communications circuits also meet the requirements for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSA C22.1). Conditions for use are as specified in the I/A Series DIN Rail Mounted Subsystem User's Guide (B0400FA).

*European Low Voltage Directive 73/23/EEC and Explosive Atmospheres (ATEX) directive 94/9/EC*

CENELEC (DEMKO) certified as EEx nA IIC T4 for use in CENELEC certified Zone 2 enclosure certified as associated apparatus for supplying non-incendive field circuits for Zone 2, Group IIC, potentially explosive atmospheres when connected to specified I/A Series processor modules as described in the I/A Series DIN Rail Mounted Subsystem User's Guide (B0400FA). Also, see Table 1 on page 10.

### Calibration Requirements

Calibration of the module or termination assembly is not required.

**ENVIRONMENTAL SPECIFICATIONS<sup>(4)</sup>****Operating****TEMPERATURE***Module*

-20 to +70°C (-4 to +158°F)

*Termination Assembly**PVC*

-20 to +50°C (-4 to +122°F)

*PA*

-20 to +70°C (-4 to +158°F)

**RELATIVE HUMIDITY**

5 to 95% (noncondensing)

**ALTITUDE**

-300 to +3,000 m (-1,000 to +10,000 ft)

**Storage****TEMPERATURE**

-40 to +70°C (-40 to +158°F)

**RELATIVE HUMIDITY**

5 to 95% (noncondensing)

**ALTITUDE**

-300 to +12,000 m (-1,000 to +40,000 ft)

**Contamination**

Suitable for use in Class G3 (Harsh) environments as defined in ISA Standard S71.04, based on exposure testing according to EIA Standard 364-65, Class III.

**Vibration**

7.5 m/S<sup>2</sup> (0.75 g) from 5 to 500 Hz

---

(4) The environmental limits of this module may be enhanced by the type of enclosure containing the module. Refer to the applicable Product Specification Sheet (PSS) which describes the specific type of enclosure that is to be used.

## PHYSICAL SPECIFICATIONS

### Mounting

#### MODULE

FBM216 mounts on a modular baseplate. The baseplate can be mounted on a DIN rail (horizontally or vertically), or horizontally on a 19-inch rack using a mounting kit. Refer to PSS 21H-2W6 B4 for details.

#### TERMINATION ASSEMBLY

The TA mounts on a DIN rail and accommodates multiple DIN rail styles including 32 mm (1.26 in) and 35 mm (1.38 in).

### Mass

#### MODULE

284 g (10 oz) approximate

#### TERMINATION ASSEMBLY

##### *Compression*

181 g (0.40 lb) approximate

##### *Ring Lug*

249 g (0.55 lb) approximate

### Dimensions – Module

#### HEIGHT

102 mm (4 in)

114 mm (4.5 in) including mounting lugs

#### WIDTH

45 mm (1.75 in)

#### DEPTH

104 mm (4.11 in)

### Dimensions – Termination Assembly

See page 11.

### Part Numbers

#### FBM216 MODULE

P0922VV

#### TERMINATION ASSEMBLIES

See “FUNCTIONAL SPECIFICATIONS – TERMINATION ASSEMBLIES” on page 9

#### REDUNDANT ADAPTER

P0917XQ

### Termination Cables

#### CABLE LENGTHS

Up to 30 m (98 ft)

#### CABLE MATERIALS

Polyurethane or Hypalon®/XLP

#### TERMINATION CABLE TYPE

Types 1 – See Table 2 on page 10.

#### CABLE CONNECTION – TA

25-pin male D-subminiature

### Construction – Termination Assembly

#### MATERIAL

Polyvinyl Chloride (PVC), compression

Polyamide (PA), compression

PVC, ring lug

#### FAMILY GROUP COLOR

Green – communication

#### TERMINAL BLOCKS

3 tiers, 8 positions

### Field Termination Connections

#### COMPRESSION-TYPE ACCEPTED WIRING SIZES

##### *Solid/Stranded/AWG*

0.2 to 4 mm<sup>2</sup>/0.2 to 2.5 mm<sup>2</sup>/24 to 12 AWG

##### *Stranded with Ferrules*

0.2 to 2.5 mm<sup>2</sup> with or without plastic collar

#### RING-LUG TYPE ACCEPTED WIRING SIZES

#6 size connectors (0.375 in (9.5 mm))

0.5 to 4 mm<sup>2</sup>/22 AWG to 12 AWG

## TERMINATION ASSEMBLIES AND CABLES

Field input signals connect to the FBM subsystem via DIN rail mounted Termination Assemblies, which are **electrically passive**. TAs for the FBM216 are available in the following forms:

- ▶ Compression screw type using Polyvinyl Chloride (PVC) material
- ▶ Compression screw type using Polyamide (PA) material
- ▶ Ring lug type using PVC material

See the following “FUNCTIONAL SPECIFICATIONS – TERMINATION ASSEMBLIES” for a list of TAs used with the FBM216.

The FBM216 provides sufficient loop resistance to allow use of the HART Hand-Held Terminal, or PC20

Intelligent Field Device Configurator (PSS 2A-1Z3 E). A removable termination cable connects the DIN rail mounted TA to the FBM via a field connector on the baseplate in which the FBM is installed. Termination cables are available in the following materials:

- ▶ Polyurethane
- ▶ Hypalon XLP.

Termination cables are available in a variety of lengths, up to 30 meters (98 feet), allowing the Termination Assembly to be mounted in either the enclosure or in an adjacent enclosure. See Table 2 for a list of termination cables used with the TAs for the FBM216.

## FUNCTIONAL SPECIFICATIONS – TERMINATION ASSEMBLIES

FBM Type	Input Signal	TA Part Number		Termination	TA Cable	TA Certification
		PVC <sup>(a)</sup>	PA <sup>(a)</sup>			
FBM216	8 input channels, 4 to 20 mA analog signal, alone or with HART signal superimposed	P0916BX P0926EA	P0926TD	C RL	1	1, 2

(a) PVC is polyvinyl chloride rated from -20 to +50°C (-4 to +122°F). PA is Polyamide rated from -20 to +70°C (-4 to +158°F).

(b) C = TA with compression terminals; RL = TA with ring lug terminals.

(c) See Table 2 for cable part numbers and specifications.

(d) See Table 1 for Termination Assembly certification definitions.

**Table 1. Certification for Termination Assemblies**

Type	Certification <sup>(a)</sup>
Type 1	TAs are UL/UL-C listed as suitable for use in Class I; Groups A-D; Division 2 temperature code T4 hazardous locations. They are CENELEC (DEMKO) certified EEx nA IIC T4 for use in Zone 2 potentially explosive atmospheres.
Type 2	TAs are UL/UL-C listed as associated apparatus for supplying non-incendive field circuits Class I; Groups A-D; Division 2 hazardous locations when connected to specified DIN rail mounted FBMs and field circuits meeting entity parameter constraints specified in <i>DIN Rail Mounted Subsystem User's Guide</i> (B0400FA). They are also CENELEC (DEMKO) certified as associated apparatus for supplying field circuits for Group IIC, Zone 2 potentially explosive atmospheres. Field circuits are also Class 2 limited energy (60 V dc, 30 V ac, 100 VA or less) if customer-supplied equipment meets Class 2 limits.

(a) All TAs are UL/UL-C listed to comply with applicable ordinary location safety standards for fire and shock hazards. Hazardous location types comply with ATEX directive for II 3 G use. They also comply with the requirements of the European Low Voltage Directive. All listings/certifications require installation and use within the constraints specified in *DIN Rail Mounted Subsystem User's Guide* (B0400FA) and the conditions stated in UL and DEMKO reports.

**Table 2. Cables Types and Part Numbers**

Cable Length m (ft)	Type 1 P/PVC <sup>(a)</sup>	Type 1 H/XLPE <sup>(b)</sup>	Cable Length m (ft)	Type 1 P/PVC <sup>(a)</sup>	Type 1 H/XLPE <sup>(b)</sup>
0.5 (1.6)	P0916DA	P0916VA	10.0 (32.8)	P0916DE	P0916VE
1.0 (3.2)	P0916DB	P0916VB	15.0 (49.2)	P0916DF	P0916VF
2.0 (6.6)	P0931RM	P0931RR	20.0 (65.6)	P0916DG	P0916VG
3.0 (9.8)	P0916DC	P0916VC	25.0 (82.0)	P0916DH	P0916VH
5.0 (16.4)	P0916DD	P0916VD	30.0 (98.4)	P0916DJ	P0916VJ


(a) P/PVC is polyurethane outer jacket and semi-rigid PVC primary conductor insulation.

(b) H/XLPE is Hypalon outer jacket and XLPE (cross-linked polyethylene) primary conductor insulation.


## DIMENSIONS – NOMINAL

[mm]  
in

Compression Termination Assembly

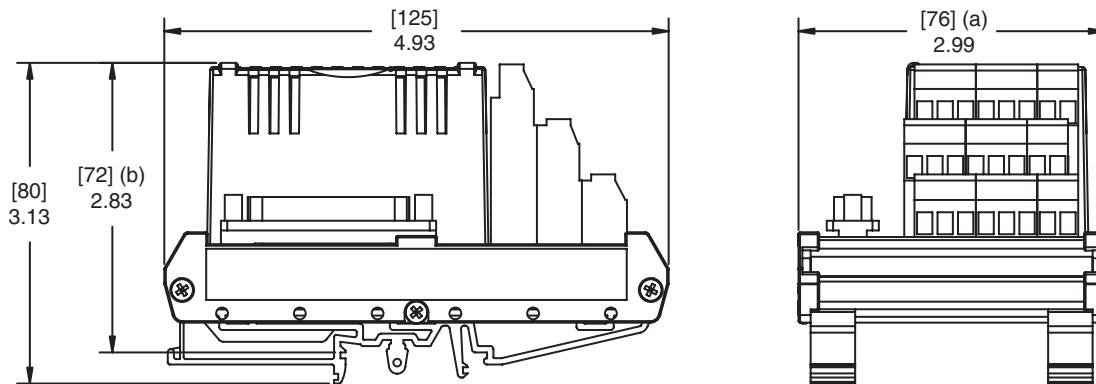

Ring Lug Termination Assembly

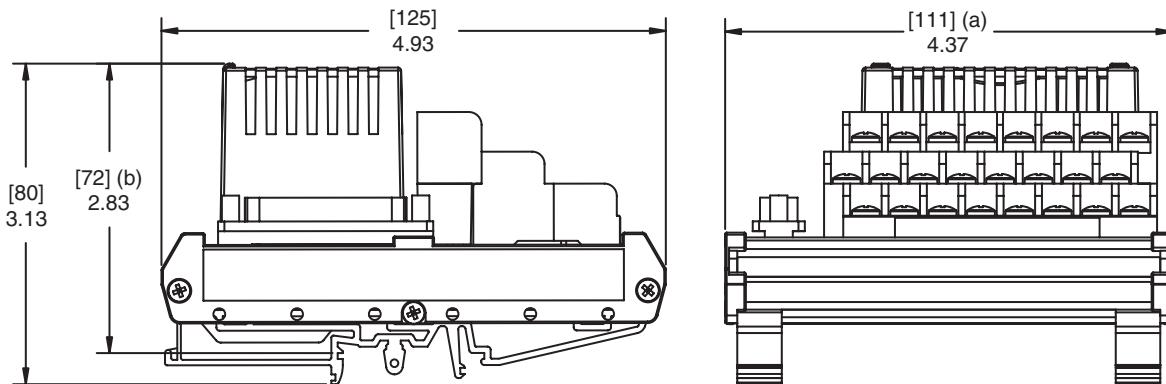

(a) Overall width – for determining DIN rail loading.

(b) Height above DIN rail (add to DIN rail height for total).

**RELATED PRODUCT SPECIFICATION SHEETS**

<b>PSS Number</b>	<b>Description</b>
PSS 21H-2W1 B3	DIN Rail Mounted FBM Subsystem Overview
PSS 21H-2W2 B3	DIN Rail Mounted FBM Equipment, Agency Certifications

IPS Corporate Headquarters  
5601 Granite Parkway Suite 1000  
Plano, TX 75024  
United States of America  
[www.ips.invensys.com](http://www.ips.invensys.com)

Foxboro Global Client Support  
Inside U.S.: 1-866-746-6477  
Outside U.S.: 1-508-549-2424 or  
contact your local Foxboro  
representative.  
Facsimile: 1-508-549-4999

Invensys, Foxboro, I/A Series and the IPS Logo are trademarks of Invensys plc, its subsidiaries, and affiliates. All other brand names may be trademarks of their respective owners.

Copyright 2002-2009 Invensys Systems, Inc.  
All rights reserved

MB 21A

Printed in U.S.A.

0809